


1808-1810 Septic Tank Location



The location of the septic tank openings for 1808-1810 are identified by the blue dots in the flower bed on the west side of 1804. The primary opening is covered by small rocks and is 2' south of the 1802 deck, and 2' east of the top of the deck stairs. The second opening was not specifically located, but is anticipated to be 2-3' directly west of the primary opening close to the bottom of the deck stairs. This will likely require the removal of some plants if the second tank is opened up. The depth of the primary tank lid is approximately 10".

Note: Sprinkler lines and a sprinkler head are very close to the tank openings. Dig carefully.

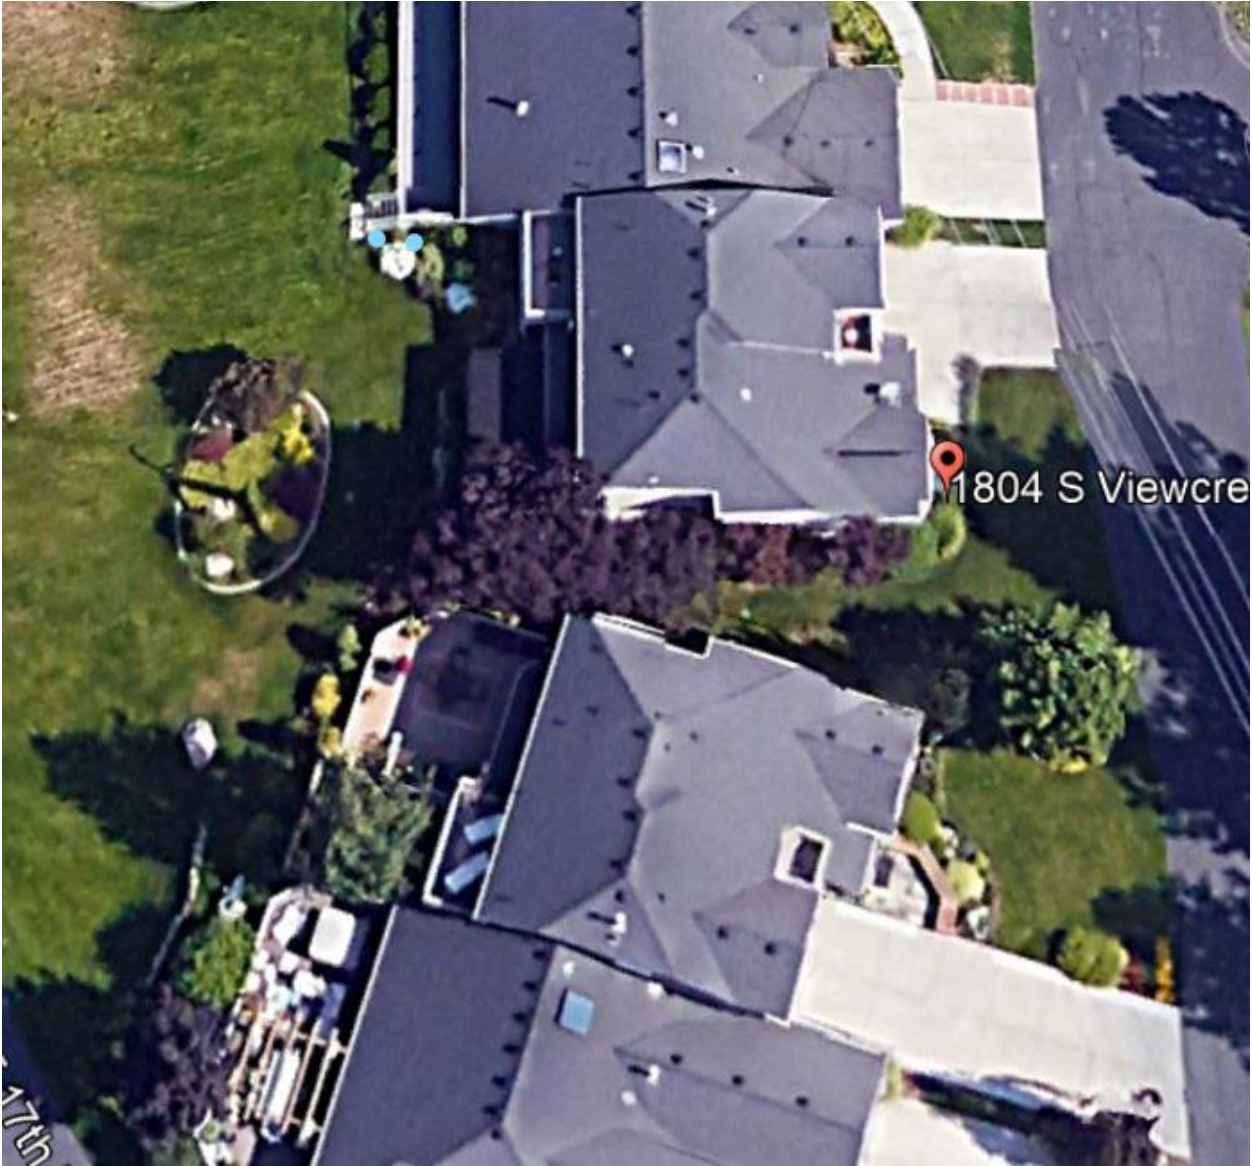